


## Genotyping Report

Strain ID	T015266	Strain Type	CKO(Cas9)	Genetic Background	C57BL/6JGpt
Designer	Zifan Lin	Gene Name	<i>Smarch1</i>		

### 1. Strategy of Genotyping

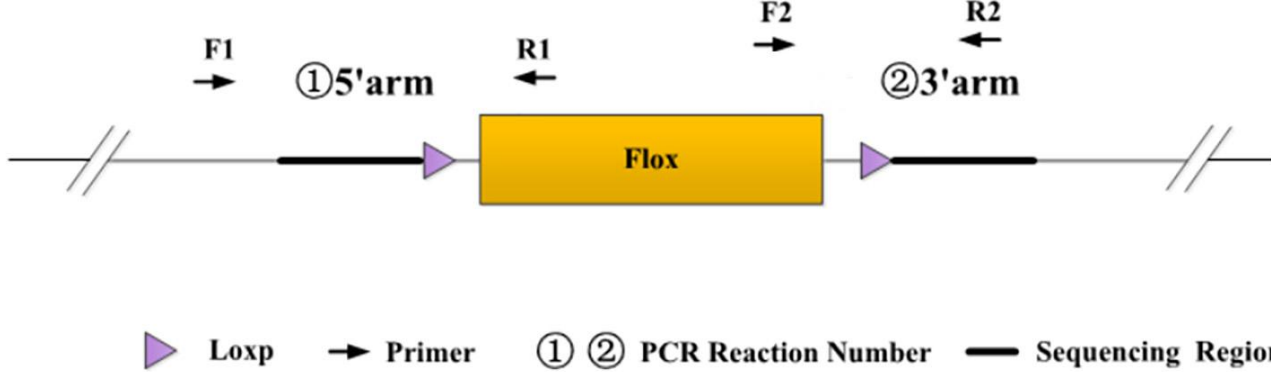


▶ **Loxp**    **➔** **Primer**    ① ② **PCR Reaction Number**    **—** **Sequencing Region**

Wild type: ①PCR reaction obtains a single WT band; ②PCR reaction obtains none band.  
 Heterozygote: ①PCR reaction obtains a WT band and a Targeted band; ②PCR reaction obtains a Targeted band.  
 Homozygote: ①PCR reaction obtains a single Targeted band; ②PCR reaction obtains a Targeted band.  
 Note: The sizes of WT and Targeted band are shown below.

### 2. Primer Information

PCR No.	Primer No.	Primer Name	Sequence	Band Size
①(5'arm)	F1	T015266-F1	GCACCTCACACCCATCTATTGGTT	WT: 291bp Targeted: 396bp
	R1	T015266-R1	GTCCCGTTGCCTATGTTGCTTTG	
②(3'arm)	F2	T015266-F2	GAGACAGGGTTTCTCTGTGCAGT	WT: 0bp Targeted: 340bp
	R2	T015266-R2	CACAACGCGTTCTTCTGTTAGTCC	

### 3. Gel Image & Conclusion

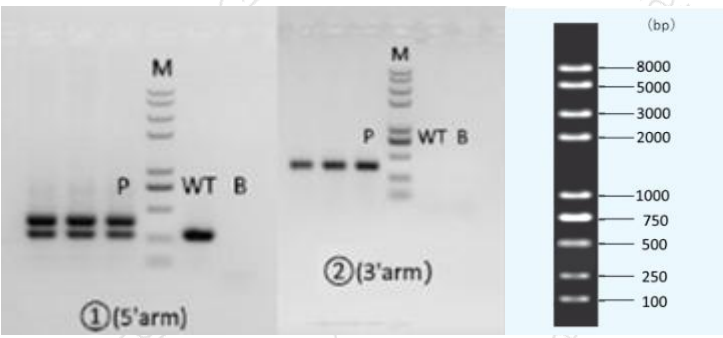

Note: P: Heterozygous samples; WT: Wildtype control; B: Blank control (ddH<sub>2</sub>O); M: DNA Ladder

- ① Control (WT) : It is an important reference mark for whether the PCR reaction is successful and whether the product band position and size meet the theoretical requirements.
- ② Control (B) : PCR amplification was performed without template in the PCR reagent to monitor whether the reagent was contaminated.

#### 4. PCR Condition

(Generally recommend to use Vazyme P222; If the sequences contain special structures such as GC%  $\geq$  60% or GC%  $\leq$  40%, recommend to use Vazyme P515.)

PCR Reaction Component			
Seg.	reaction component	Volume ( $\mu$ l)	
1	2 $\times$ Rapid Taq Master Mix (Vazyme P222)	12.5	
2	ddH <sub>2</sub> O	9.5	
3	Primer A(10pmol/ $\mu$ l)	1	
4	Primer B(10pmol/ $\mu$ l)	1	
5	Template( $\approx$ 100ng/ $\mu$ l)	1	
PCR program ① priority selection			
Seg.	Temp.	Time	Cycle
1	95°C	5min	
2	98°C	30s	20 $\times$
3	65°C* (-0.5°C/cycle)	30s	
4	72°C	45s*	
5	98°C	30s	
6	55°C*	30s	20 $\times$
7	72°C	45s*	
8	72°C	5min	
9	10°C	hold	
PCR program ② the second choice			
Seg.	Temp.	Time	Cycle
1	95°C	5min	
2	98°C	30s	35 $\times$
3	58°C*	30s	
4	72°C	45s*	
5	72°C	5min	
6	10°C	hold	

Note\*: Annealing temperature and extension time can be determined according to the actual amplification situation and amplification enzyme efficiency.

